


**MINIMUM CLEARANCES**

This appliance must be installed in compliance with all local codes and regulations. Minimum clearances may only be reduced by means approved by the regulatory authority. Flue pipe must be 6" diameter and 24 MSG steel construction. Do not use aluminum or galvanized steel. Refer to local codes and pipe manufacturer specs for required minimum clearances. **\*A minimum of 18" (450 mm) clearance from single wall pipe is required.**

RESIDENTIAL INSTALLATIONS	A	B	* C	* D	E	* F	G	H
Roof or wall exit; parallel or corner	9.5" 242 mm	1" 26 mm	20.25" 515 mm	10.25" 261 mm	1" 26 mm	13.25" 337 mm	50.5" 1283 mm	82" 2083 mm
ALCOVE INSTALLATIONS								
Roof or wall exit; requires double-wall pipe	12" 305 mm	1" 26 mm	22.75" 588 mm	10.25" 261 mm	n/a	n/a	50.5" 1283 mm	82" 2083 mm
MOBILE HOME OR TRANSPORTABLE BUILDING INSTALLATIONS								
Roof exit only; requires double-wall pipe and outside air								

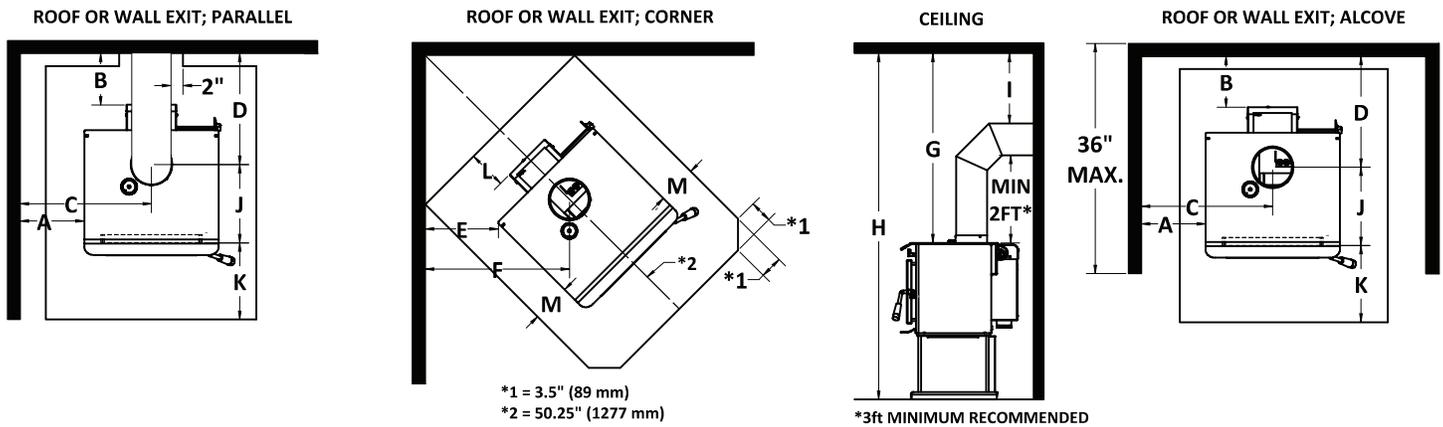

I = 18" (457 mm) for single wall pipe	J=12.25" (312 mm)	K = 18" (456 mm)	L = 8" (203 mm)	M = 8" (203 mm)
---------------------------------------	-------------------	------------------	-----------------	-----------------

**FLOOR PROTECTION**

This appliance does not require thermal hearth pad floor protection; however, if installed on a combustible floor, a non-combustible floor shield must be used. To comply with CSA B365, any combustible covering beneath the appliance and/or within the area extending horizontally at least 18" (450 mm) beyond the appliance on any side equipped with a door, and at least 8" (200 mm) beyond the appliance on other sides, shall be protected by a continuous, durable, non-combustible pad that will provide ember protection. The 18" (450 mm) ember protection required on any side with a door shall extend for the full width of the appliance plus the 8" (200 mm) required on each side of the appliance without a door. Where an appliance is installed less than 8" (200 mm) from a wall, the ember pad need only extend to the base of the wall. An ember pad shall not be placed on top of a carpet unless the pad is structurally supported to prevent displacement and distortion. A non-combustible shield is also required underneath the chimney connector and extend at least 2" on either side of the chimney connector. This shield does not need an insulation value, but must be listed under UL 1618-2009 (Type 1) and have a minimum size of:

**37" x 47.5" (940 mm x 1207 mm) in Canada**

Blaze King does not recommend adhesive based vinyl flooring in front of appliances due to thermal expansion and warping which could be permanent.